
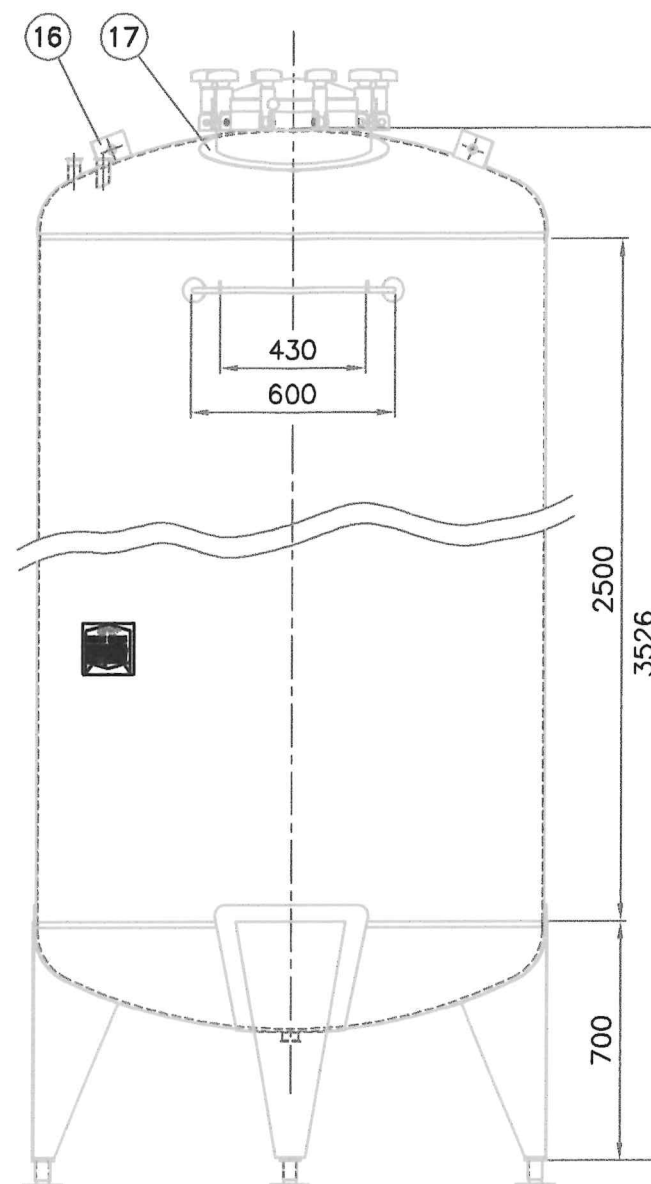


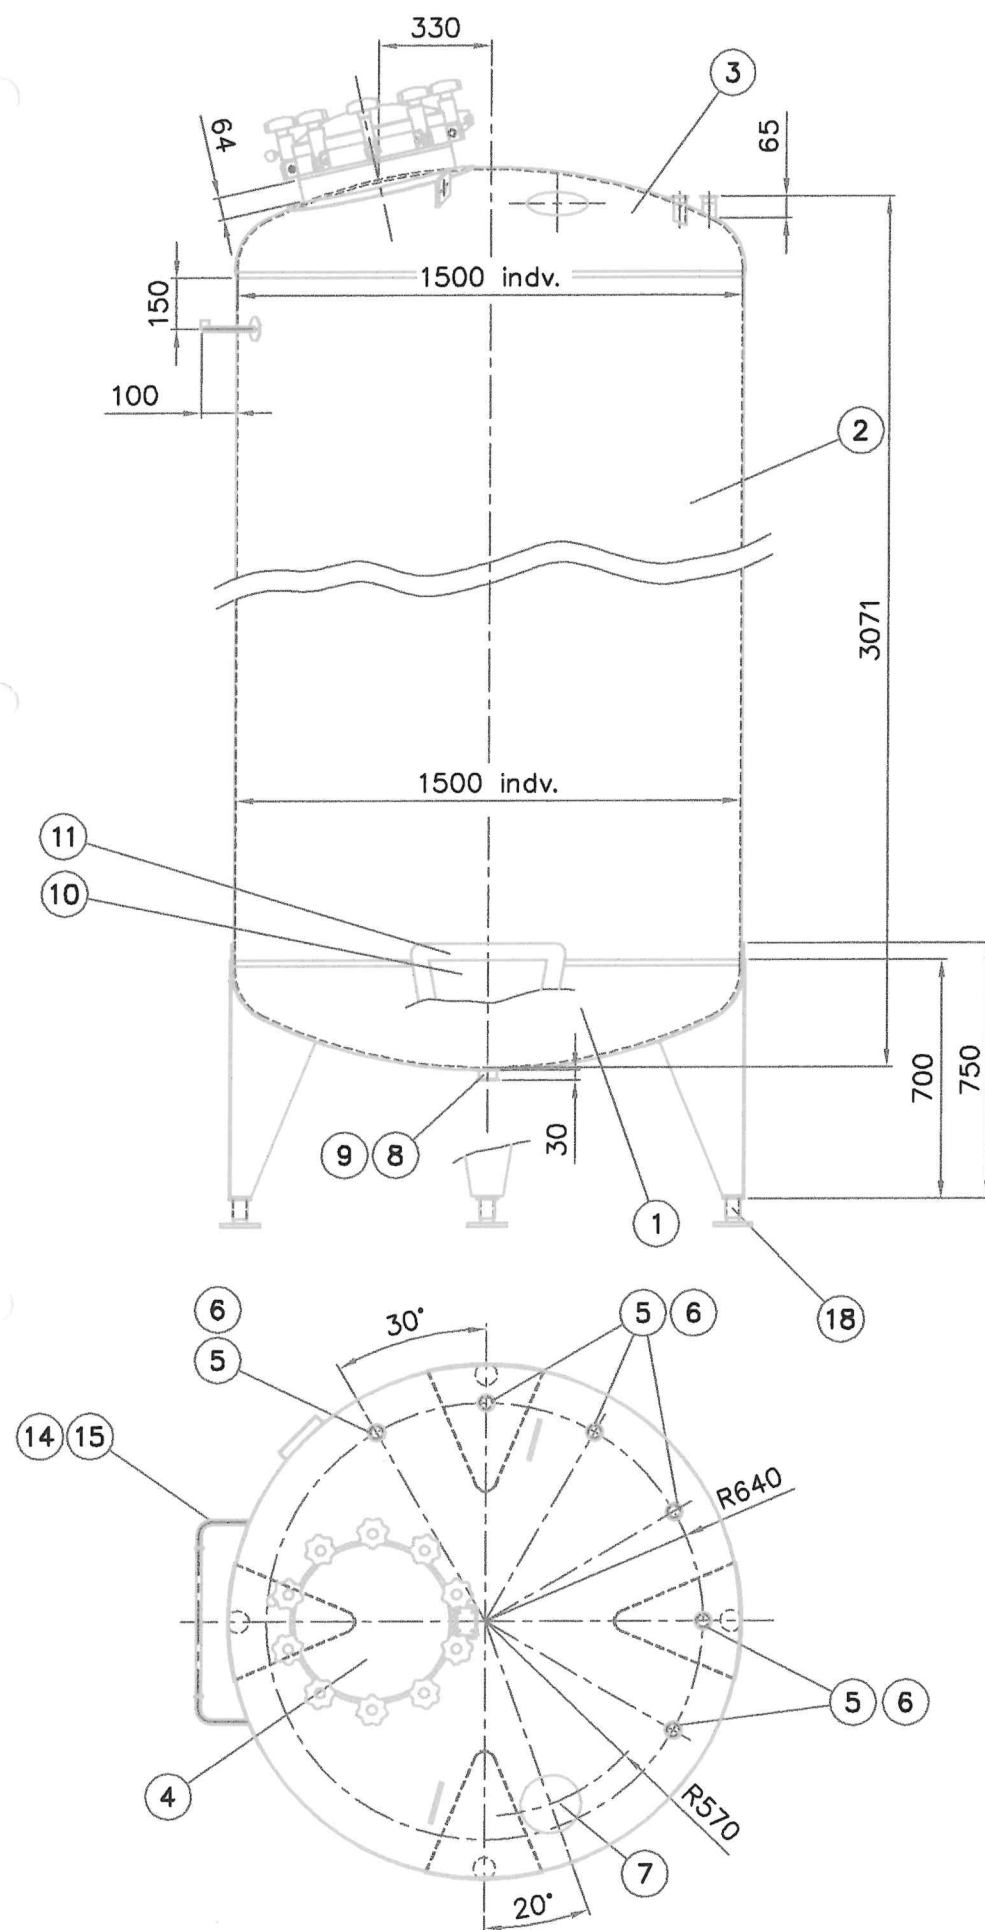

Mærkeplade:

Fremstillingsår 2004	Kategori 1
Levenummer 1003	Taramasse 900 kg
Tank Kappe	
Volumen V	5186 l
Tilladt min.-/maks. tryk PS	0 / +7 Bar
Prøvningstryk PT	10 Bar
Tilladt min.-/maks. temp. TS	0 / 30 °C
Fluida gruppe / fluida	1 / Vand, spri
Materiale	EN 1.4404
Fremstillingsnorm EN 13445	

18	4	1 1/2" Tanktæer		
17	1	Pl.3, ø556/ø456	Matr. EN1.4404	EN10028-7
16	2	Pl. 8 mm	Matr. EN1.4404	EN10028-7
15	2	Pl.3, ø70	Matr. EN1.4404	EN10028-7
14	1	ø14	Matr. EN1.4404	
13				
12				
11	4	Pl.3	Matr. EN1.4404	EN10028-7
10	4	Pl.3	Matr. EN1.4404	EN10028-7
9	1	Rør ø51x1,2	Matr. EN1.4404	EN1127/DIN17457
8	1	Clamp ø51	Matr. EN1.4404	
7	1	Skueglas ø125	Matr. EN1.4404	Lev. Høyers Mask.
6	6	Rør ø38x1,2	Matr. EN1.4404	EN1127/DIN17457
5	6	Clamp ø38	Matr. EN1.4404	
4	1	Mandedæksel HLSD	Matr. EN1.4404	Str. 450, 10 skruer
3	1	Kløp.bund ø1516x8	Matr. EN1.4404	DIN28011, EN10028-7
2	1	Pl. 4	Matr. EN1.4404	EN10028-7
1	1	Kløp.bund ø1516x8	Matr. EN1.4404	DIN28011, EN10028-7
Pos	Stk	Beskrivelse	Materiale	Bemærkning

		Scale 1:15	Weight
Draw.nr. 195266-2		Material EN1.4404	
Date 01.12.03		Name AAR	
Item Tank, 13AT		Customer Novo Nordisk	
Part			
e 3039-33071	17.05.04	AAR	
d Diverse endr.	24.03.04	AAR	
c Stholder endr.	17.02.04	AAR	
b Navn & PS endr.	03.02.04	AAR	
a Diverse endr.	29.01.04	AAR	
No	Alterations	Date	Name